

EMS Turnout Time Defect Rate Louisville Fire Department



KPI Owner: Fire Department Chief of Staff


Process: Fire Response

Baseline, Goal, & Benchmark	Source Summary	Continuous Improvement Summary
Baseline: FY 14 avg. = 83.7% Goal: No more than 10% of incidents have a late turnout time (>60 sec) by first responding unit. Benchmark: 90% within 60 seconds	Data Source: Firehouse Analytics Goal Source: NFPA 1710 Benchmark Source: NFPA 1710	Plan-Do-Check-Act Step 3: Determine and quantify root causes Measurement Method: Percentage of incidents in which the first responding unit took more than 60 seconds to turnout to an incident. Why Measure: Assure members are efficiently reacting to calls for service Next Improvement Step: 1. Assure proper measuring 2. Educate Suppression members on proper response techniques

How Are We Doing?

Mar2014-Feb2015 12 Month Goal	Mar2014-Feb2015 12 Month Actual		Feb2015 Goal	Feb2015 Actual	
10	73	🚦	10	69	🚦
Percent	Percent		Percent	Percent	

EMS Turnout Time Defect Rate

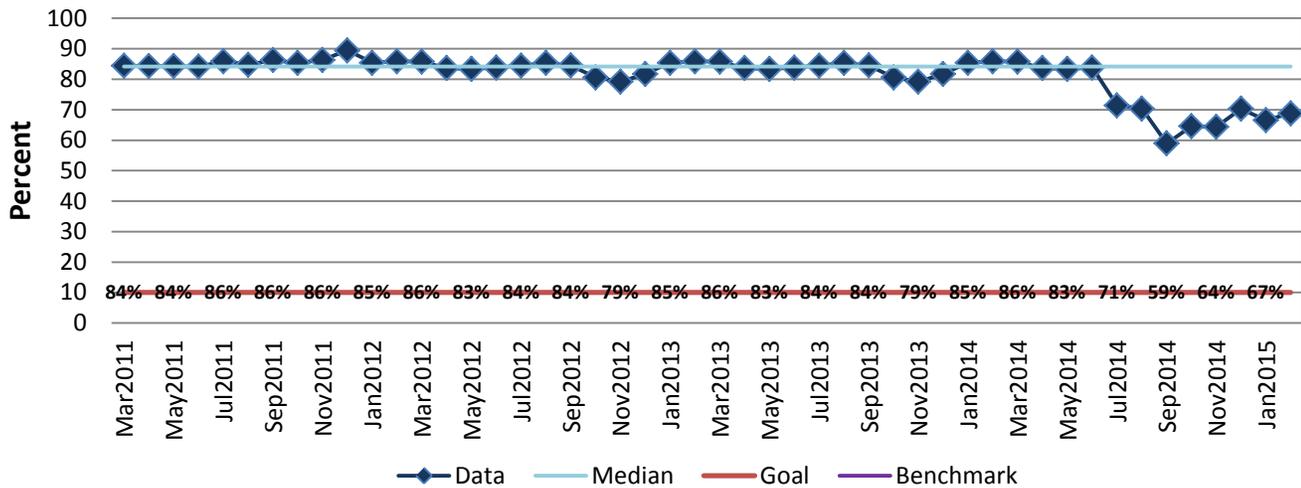

February 2015 Turnout Time Breakdown in Seconds

